

## Installation Area Soil Summary Report

### GENERAL INFORMATION

Date September 6, 2005 Submitted to Madison County Health Department  
Applican Graystone Homes, Inc. Telephone (540) 825-1300  
Address 1202 Orange Rd., Culpeper, VA. 22701  
Owner Same Address Same  
Location From Madison, Rte. 607 South to left Rte. 614, property is on right  
Tax Map 50-56 & 58 Subdivision  
Block/Sec. Lot 2, Site 3-M Installation, Lower 5 lines: Conventional trench

### SOIL INFORMATION SUMMARY

1. Position in landscape satisfactory Yes  No

Open Piedmont Sideslope

2. Slope 17 %

3. Depth to rock or impervious strata: Max. \_\_\_\_\_ Min. \_\_\_\_\_ None

4. Depth to seasonal water table (gray mottling or gray color) No  Yes  \_\_\_\_\_ inches

5. Free water present No  Yes  \_\_\_\_\_ range in inches

6. Soil percolation rate estimated Yes  No  Texture group II/III

Estimated Rate 45-50

7. Permeability test performed Yes  No

*\*All applicable regulations as well as the specific soil and site conditions (including the trench sidewalls) were taken into account when the estimated percolation rate was assigned.*

If yes, note type of test performed and attach


Site Approved: Primary drainfield to be placed at 36 inch depth at site designated on permit.

If required, reserve drainfield to be placed at 24 inches as designated on

Site Disapproved

Reasons for rejection:

1.  Position in landscape subject to flooding or periodic saturation.
2.  Insufficient depth of suitable soil over hard rock.
3.  Insufficient area of acceptable soil for required drainfield, and/or Reserve Area
4.  Rates of absorption too slow.
5.  Insufficient area of acceptable soil for required drainfield, and/or Reserve Area
6.  Proposed system too close to well.
7.  Other \_\_\_\_\_



(attach additional pages if necessary)

*The information presented in this submittal package represents the best available information as of the evaluation date noted on the next page of this package. Due to the potential for subsequent events to negatively impact the recommendations made in this package, it is our firm's very strong recommendation to submit this documentation to the local health department for approval as soon as it is received by the client. Failure to do so may render the information contained in this package void. M & M Soil Consultants, Inc., as well as the certifying individual, accepts no liability for subsequent events that occur after the date of the evaluation.*

## Reserve Area Soil Summary Report

### GENERAL INFORMATION

Date September 6, 2005 Submitted to Madison County Health Department  
Applican Graystone Homes, Inc. Telephone (540) 825-1300  
Address 1202 Orange Rd., Culpeper, VA. 22701  
Owner Same Address Same  
Location From Madison, Rte. 607 South to left Rte. 614, property is on right  
Tax Map 50-56 & 58 Subdivision  
Block/Sec. Lot 2, Site 3-M Reserve, Upper 6 lines: Conventional trench

### SOIL INFORMATION SUMMARY

1. Position in landscape satisfactory Yes  No

Open Piedmont Sideslope

2. Slope 17 %

3. Depth to rock or impervious strata: Max. \_\_\_\_\_ Min. 44" None (Hole #2)

4. Depth to seasonal water table (gray mottling or gray color) No  Yes  \_\_\_\_\_ inches

5. Free water present No  Yes  \_\_\_\_\_ range in inches

6. Soil percolation rate estimated Yes  No  Texture group III  
Estimated Rate 55-60

7. Permeability test performed Yes  No

*\*All applicable regulations as well as the specific soil and site conditions (including the trench sidewalls) were taken into account when the estimated percolation rate was assigned.*


If yes, note type of test performed and attach

Site Approved: Primary drainfield to be placed at 36 inch depth at site designated on permit.  
If required, reserve drainfield to be placed at 24 inches as designated on

Site Disapproved

Reasons for rejection:

1.  Position in landscape subject to flooding or periodic saturation.
2.  Insufficient depth of suitable soil over hard rock.
3.  Insufficient area of acceptable soil for required drainfield, and/or Reserve Area
4.  Rates of absorption too slow.
5.  Insufficient area of acceptable soil for required drainfield, and/or Reserve Area
6.  Proposed system too close to well.
7.  Other \_\_\_\_\_



(attach additional pages if necessary)

## SOIL PROFILE DESCRIPTION REPORT

Date of Evaluation May 27, 2005

**Sheffield Estates, Lot 2, Site 3-M**

Where the local health department conducts the soil evaluation, the location of profiles holes may be shown on the schematic drawing on the construction permit or the sketch submitted with the application. If soil evaluations are conducted by a private soil scientist, location of profile holes and sketch of the area investigated including all structural features, i.e., sewage disposal systems, wells, etc., within 100 feet of site (See Section 4) and reserve site shall be shown on the reverse side of this page or prepared on a separate page and attached on this form.

See application sketch page       See construction permit       See sketch attached to this form

Hole	Horizon	Depth (inches)	Description of color, texture, etc.	Texture Group
1	Ap	0-8	7.5YR 4/3 Loam, Friable	IIB
	Bt	8-20	2.5YR 4/6, 4/8, 5YR 5/8 Clay Loam, Friable to Firm, 2-3 msbk	III
	BC	20-34	2.5YR 4/6, 4/8, 5YR 5/8, 6/8, 7.5YR 6/8 Heavy Loam, Friable, 1 msbk	IIB
	C	34-60	Multicolored 2.5YR 4/6, 4/8, 5YR 5/8, 6/8, 7.5YR 6/6, 6/8, 2.5Y 5/4, 5/6, 6/6 Loam, Very Friable	IIB
2	Ap	0-6	7.5YR 4/3, 5YR 4/4 Heavy Loam, Friable	IIB
	Bt	6-24	2.5YR 4/6, 4/8, 5YR 5/8, 7.5YR 5/8 Clay Loam, Firm, 2 msbk	III
	BC	24-44	2.5YR 4/6, 4/8, 5YR 5/8, 2.5Y 4/4, 5/4, 7.5YR 5/8, 6/6 Heavy Loam to Light Clay Loam, Friable, IIB/III channery in spots	IIB/III
	Cr	44+		
3	Ap	0-8	7.5YR 4/3, 4/4 Loam, Friable	IIB
	Bt	8-26	5YR 4/6, 5/6 Light Clay Loam, Firm, 2 msbk	III
	BC	26-32	2.5YR 4/6, 5YR 5/8, 7.5YR 5/6 Light Clay Loam, Friable, 1 msbk	III
	C	32-60	Multicolored 2.5YR 4/6, 5YR 5/8, 7.5YR 6/6, 2.5Y 5/6, 6/6, 5/4 Loam to Fine Sandy Loam, Very Friable	IIB/A
4	Ap	0-3	7.5YR 4/3 Loam, Friable	IIB
	Bt	3-20	2.5YR 4/6, 2.5Y 5/4, 5/6 Light Clay Loam, Friable to Firm, 2 msbk	III
	C	20-60	Multicolored 2.5YR 4/6, 5YR 5/6, 5/8, 6/6, 7.5YR 6/6, 2.5Y 5/4, 5/6, 6/4, 6/6 Fine Sandy Loam, Very Friable	IIA
5	Ap	0-7	7.5YR 4/3 Heavy Loam, Friable	IIB
	Bt	7-23	2.5YR 4/6, 5YR 4/6 Clay Loam, Firm, 2-3 msbk	III
	BC	23-42	2.5YR 4/6, 4/8, 7.5YR 5/8, 6/6, 10YR 6/8 Light Clay Loam, Friable to Firm, 1-2 msbk	III
	C	42-60	Multicolored 2.5YR 4/6, 5YR 5/8, 7.5YR 5/8, 6/6, 2.5Y 5/4, 5/6 Loam, Friable	IIB



**Abbreviated Design Form** (*Installation, Lower 5 lines: Conventional trench*), Site 3-M

**Design Basis**

A. a. Estimated Percolation Rate (minutes per inch)	45-50
b. Recommended trench bottom (inches)	36
c. Depth to restrictive feature or to limit of evaluation (inches)	60
d. Minimum separation distance required (18 inches for conventional systems)	18
e. Separation distance in inches provided in design (Ac-Ab)	24
f. Minimum trench bottom due to slope in inches $[(\% \text{ slope} \cdot 8)/2 + (18)]$	22
g. Is the slope greater than 10%? (If no, go to line Ai; if yes, go to line Ah)	Yes
h. If slope is >10%, does 24 inches to a restriction exist below trench bottom in Ab?	Yes
i. Additional center-to-center spacing required in feet. (If no to Ag, insert 0. If yes to Ag and yes to Ah, insert 0 from 10 to 19% slope, insert 1 from 20 to 29% slope, insert 2 from 30 to 39% slope, insert 3 from 40 to 49% slope. If yes to Ag and no to Ah, insert 1 from 10 to 19% slope, insert 2 from 20 to 29% slope, insert 3 from 30 to 39% slope, insert 4 from 40 to 49% slope.)	0
B. Trench bottom sq. ft. required per bedroom from Table 5.4 using the gravity column	360
C. Number of Bedrooms	4

**Area Calculations**

D. Length of trench (across slope)	100 feet
Length of available area (across slope)	100 feet
E. Width of trench	3 feet
F. Number of trenches	5
G. Center-to-center spacing	9 feet
H. a. Width required downslope $(G(F-1) + E)$	39 feet
b. Total width of available area (includes area allocated for reserve)	102 feet
I. Total square footage required $(B \cdot C)$	1,440 sq. ft.
J. Square footage in design $(D \cdot E \cdot F)$	1,500 sq. ft.

K. Is a reserve area required? Yes  No

Percent required:	100
Percent available:	104.17



**Notes:** 104.17% reserve is available with the 6, 100' lines remaining in this area using a conventional trench system. To the best of our knowledge and belief, this site complies with all local ordinances such as the CBPA. (Reserve area calculations are shown on a separate abbreviated design form later in this package.)

**Abbreviated Design Form** (*Reserve, Upper 6 lines: Conventional trench*), Site 3-M

A. a. Estimated Percolation Rate (minutes per inch)	55-60
b. Recommended trench bottom (inches)	24
c. Depth to restrictive feature or to limit of evaluation (inches)	44
d. Minimum separation distance required (18 inches for conventional systems)	18
e. Separation distance in inches provided in design (Ac-Ab)	20
f. Percent slope	17
f. Minimum trench bottom due to slope in inches $[(\% \text{ slope} - 8)/2 + (18)]$	22
h. Is the slope greater than 10%? (If no, go to line Ai; if yes, go to line Ah)	Yes
i. If slope is >10%, does 24 inches to a restriction exist below trench bottom in Ab?	No
j. Additional center-to-center spacing required in feet. (If no to Ah, insert 0. If yes to Ah and yes to Ai, insert 0 from 10 to 19% slope, insert 1 from 20 to 29% slope, insert 2 from 30 to 39% slope, insert 3 from 40 to 49% slope. If yes to Ah and no to Ai, insert 1 from 10 to 19% slope, insert 2 from 20 to 29% slope, insert 3 from 30 to 39% slope, insert 4 from 40 to 49% slope.)	1
B. Trench bottom sq. ft. required per bedroom from Table 5.4 using the gravity column	432
C. Number of Bedrooms	4
<b>Area Calculations</b>	
D. Length of trench (across slope)	100 feet
Length of available area (across slope)	100 feet
E. Width of trench	3 feet
F. Number of trenches	6
G. Center-to-center spacing	10 feet
H. a. Width required downslope $(G(F \cdot 1) + E)$	53 feet
b. Total width of available area (does not include area allocated for installation)	56 feet
I. Total square footage required $(B \cdot C)$	1,728 sq. ft.
J. Square footage in design $(D \cdot E \cdot F)$	1,800 sq. ft.
K. Is a reserve area required?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Percent required: 

100
-----

Percent available: 


104.17
--------



# Site Sketch

Client: GRAYSTONE HOMES  
SHEFFIELD ESTATES Subdivision, Lot 2  
MADISON County, Virginia

Scale: 1" = 100'  
#: Profile Borings  
☒: House Site  
☒: Well Site  
On & off site features noted within 200 ft. of proposed drainfield and well areas are shown.

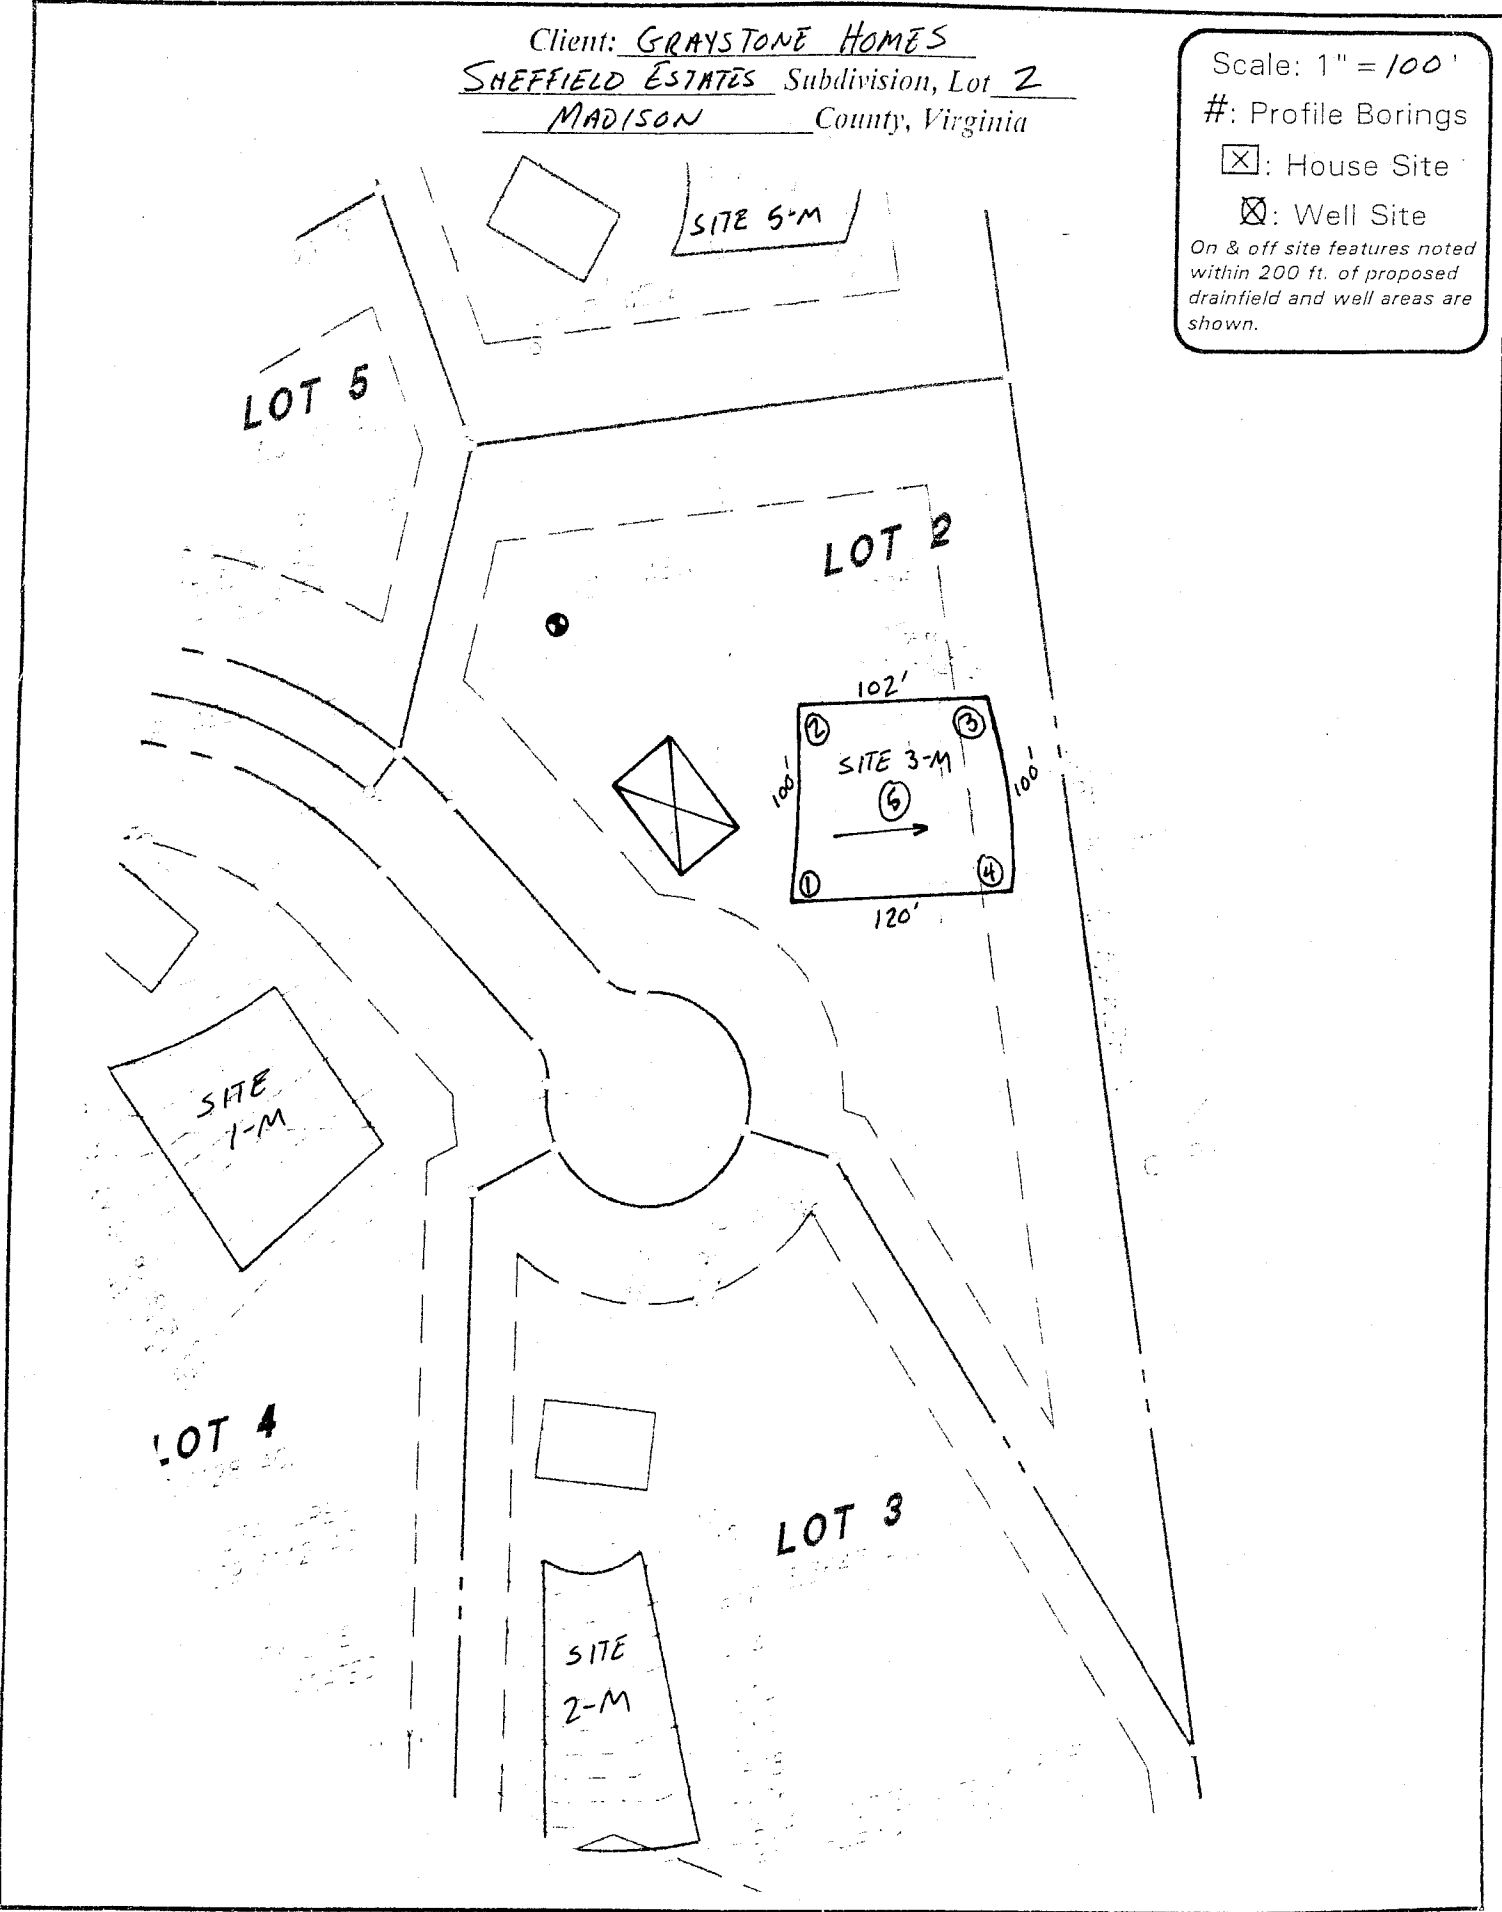

## Certification Statement


County: Madison County

Date: September 6, 2005

Property Identification: Tax Map 50-56 & 58, Sheffield Estates, Lot 2, Site 3-M

Submitted by: Glen E. McClenny

This is to certify according to subsection 32.1-163.5 of the *Code of Virginia* that work submitted for the referenced property is in accordance to and complies with the *Sewage Handling and Disposal Regulations* of the Virginia Department of Health. I recommend a Subdivision Approval be approved.

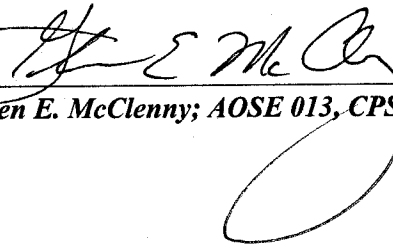AOSE   
Glen E. McClenny; AOSE 013, CPSS 3401-000049

Date: September 6, 2005

